

TAMIL NADU FIRE AND RESCUE SERVICE DEPARTMENT
NO OBJECTION CERTIFICATE

LICENSE NO. 18/V/2024
DATE :12.06.2024

Cuddalore Fire and Rescue
Service Station.

Sub: Fire and rescue service department - Cuddalore
Fire and Rescue Service Station for purpose of
No objection certificate - Reg.


Ref: (1) G.O. No. 122. School Edu (2) Dept, Date: 14.09.2004.
(2) G.O. No.123 School Edu (2) Dept, Date: 14.09.2004.
(3) Date of Requisition letter from The Correspondent,
SHREE SK VIDHYAMANDHIR.


Based on the Govt. order mentioned above and the requisition letter given by the SHREE SK VIDHYAMANDHIR, No.58/3, Vandipalayam, Cuddalore- 607 004, Tamil Nadu the building and premises comprises of G+1 owned/occupied by SHREE SK VIDHYAMANDHIR have complied with the fire prevention and fire safety requirements in accordance with rule of State Fire Service Rules, and verified on 12.06.2024. The school is granted No objection certificate for a period of one year subject to the conditions stated below.

THE ABOVE PREMISES INSPECTED BY ASSISTANT DISTRICT OFFICER FIRE & RESCUE SERVICES, G.ARUMUGAM ON 12/06/2024.

CONDITIONS

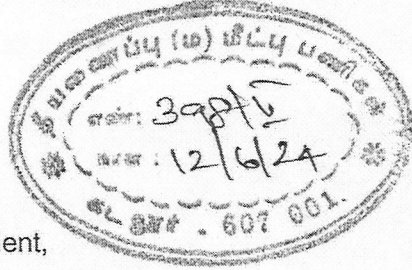
1. This License is valid for one year month from the date of issue.
 2. This No objection Certificate is issued only for approved buildings.
 3. **Four numbers of ABC 5 Kg per 200 Sq.m should be provided.**
 4. Fire Safety Systems should be maintained in good working condition.
 5. Mock drill to be conducted periodically with the help of local fire and Rescue Service Station.
 6. Any erection of permanent or temporary structure should be intimated to this department.
 7. A trained Fire Service Person, preferably retired one should be appointed.
- Further to limit the occupant load and to ensure better fire and life safety measures the following additional measures are insisted.
- a) Building occupancy capacity should not be more than 4 people per Sq. meter as per the National Building Code-2005.
 - b) The staircase treads and flooring shall be treated with rough finish (grooving) to avoid falling of children.
 - c) As per Para 6.3 of the BIS Standards IS 14435:1997 as the classrooms have only one entrance, the capacity of the class rooms shall have to be limited to 45 students.


PRINCIPAL
SHREE SK VIDHYAMANDHIR
No: 58/3, Vandipalayam, (Way to R.T.O)
Cuddalore - 607 004.



CORRESPONDENT
SHREE SK VIDHYAMANDHIR
No: 58/3, Vandipalayam, (Way to R.T.O)
Cuddalore - 607 004.

- d) Periodical maintenance and care should be taken to maintain all fire protection equipments.
- e) Mock drill has to be conducted at regular intervals in consultation with the Assistant District Officer, Fire and Rescue Services, Cuddalore Station.
- f) The class rooms should always be in the ground floor upto 3 standards. g) The classroom doors/ windows should be made of either non- combustible material or materials with high fire-resistance rating
- h) The classroom doors/ windows shall always open outwards
- i) The classroom doors/ windows shutters when opened should not obstruct movement along the exit or escape route.
- j) A Class room shall have two entrances. One door with opening towards the teachers end and the other door on the other end of the class room with only a simple latch / tower bolt arrangement for locking from inside. This door shall not have any arrangement for locking from outside.
- k) The school shall have proper Evacuation of Plan of action to rescue the children during any emergency in the school premises.
- L) Miniature Circuit Breakers/Earth Leakage Circuit Breakers should be provided.

If here is any violation and deviation from the Govt. Rule and Act the License issued will stand cancelled.



To:
The Correspondent,
SHREE SK VIDHYAMANDHIR,
No.58/3, Vandipalayam,
Cuddalore- 607 004.


உதவி மாவட்ட அலுவலர், 12/6/24
தீயணைப்பு & மீட்பு பணிகள்
கடலூர் நிலையம்